
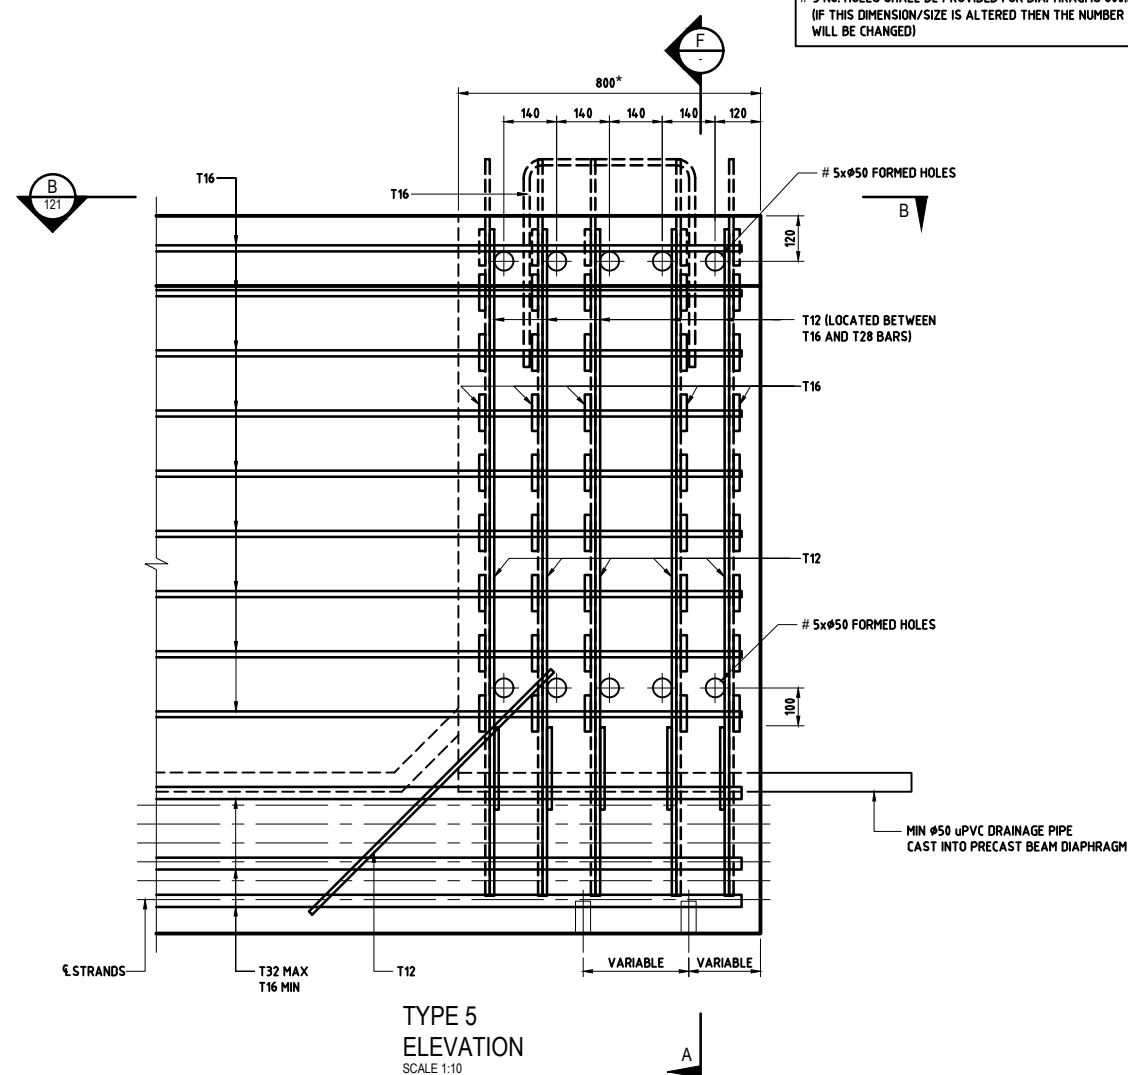
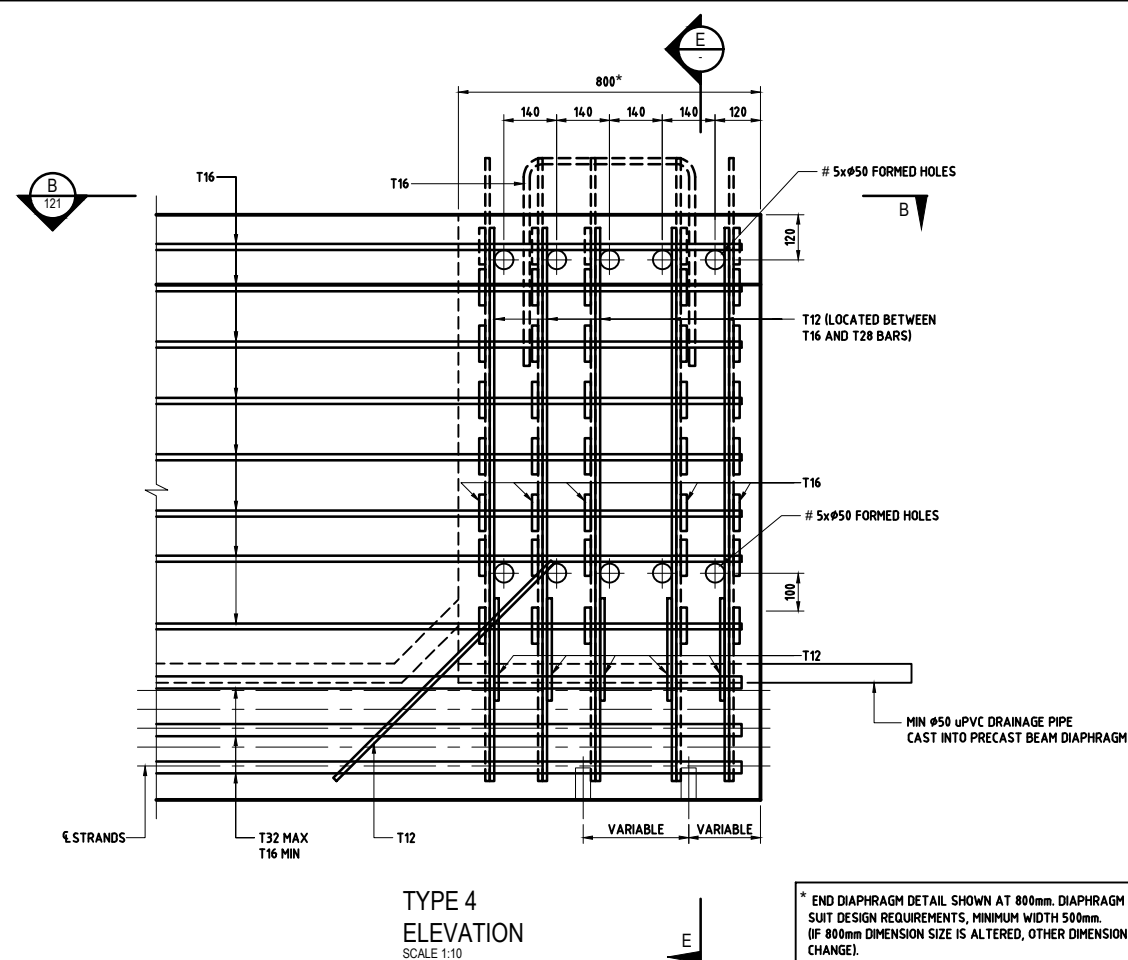
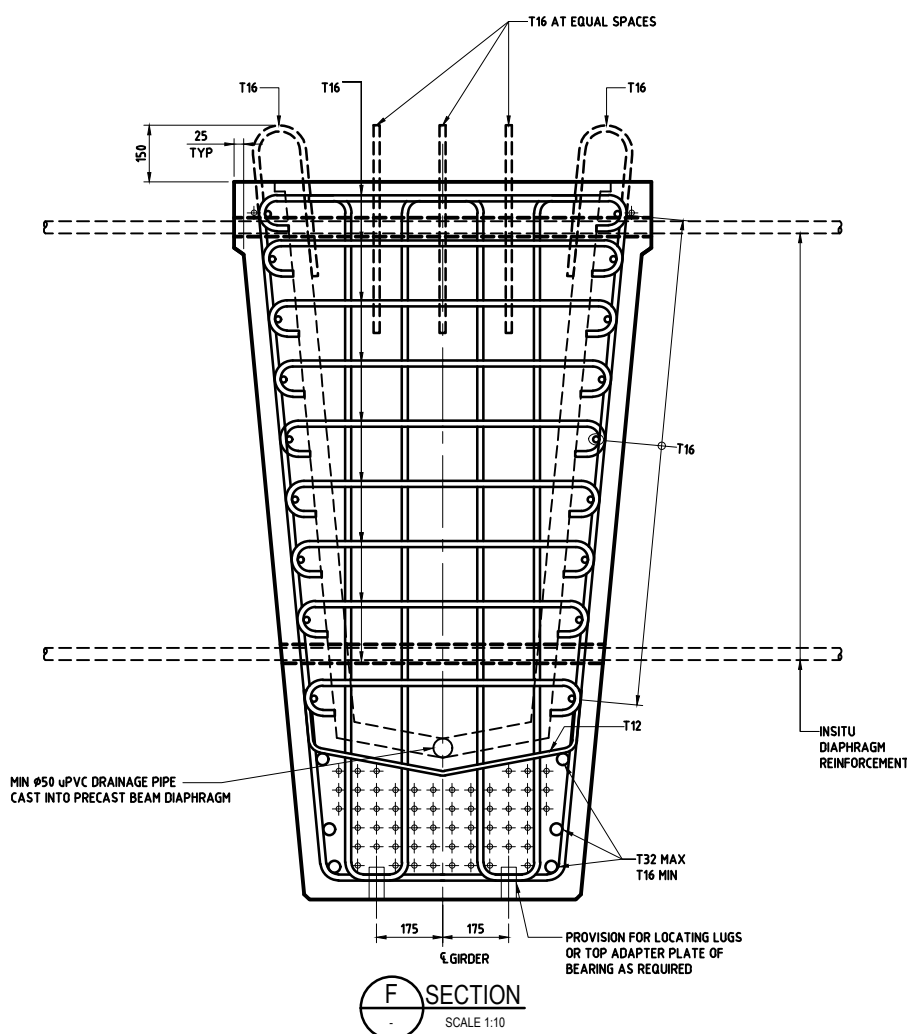


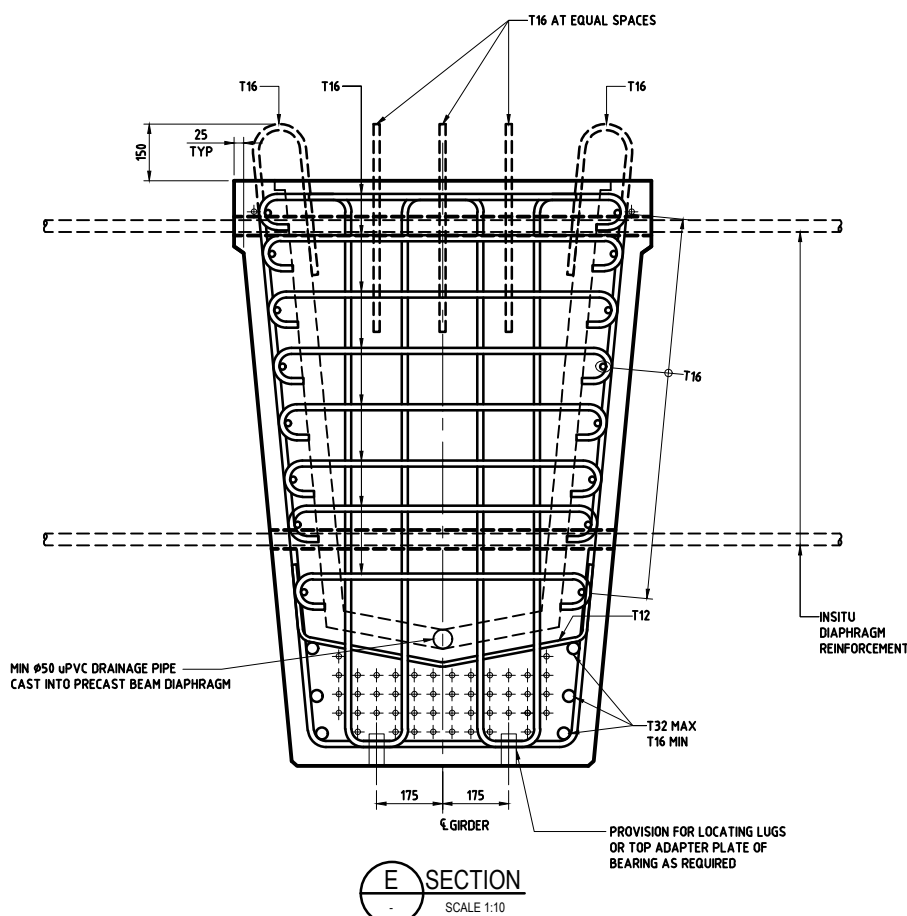

NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
- MINIMUM COVER TO BE 50mm UNLESS OTHERWISE SHOWN.
- REINFORCEMENT TO BE DEFORMED ROUND STEEL BARS TYPE 2 GRADE 500 COMPLYING WITH REQUIREMENTS OF BS 4449 AND CUT AND BENT IN ACCORDANCE WITH BS 8666.
- REINFORCEMENT SHOWN IS INDICATIVE. DESIGN DRAWINGS SHALL BE PREPARED AND DESIGNERS SHALL PROVIDE THE BAR DIAMETERS REQUIRED BY THE DESIGN.

1	23/10/2013	REVISED LOGO AND DWG NUMBER	I. FLYNN
Rev.	Date	Revision Details	Appd.
هيئة الأشغال العامة Public Works Authority			
P.O.Box 22188 Tel. : (0974) 44950000 Fax. : (0974) 44950999 www.ashghal.gov.qa			
PA PROJECTS AFFAIRS			
QCS Section: 5 (CONCRETE) PART 1 (GENERAL)			
Drawing Title: OPEN FLANGE Q-GIRDER END DIAPHRAGM REINFORCEMENT SHEET 3			
Approved: I. FLYNN		Sheet No: 1 OF 1	
Date: OCTOBER 2013		Scale: AS SHOWN @ A1	
Drawing Number: SD 5-1-106			Revision: 1