
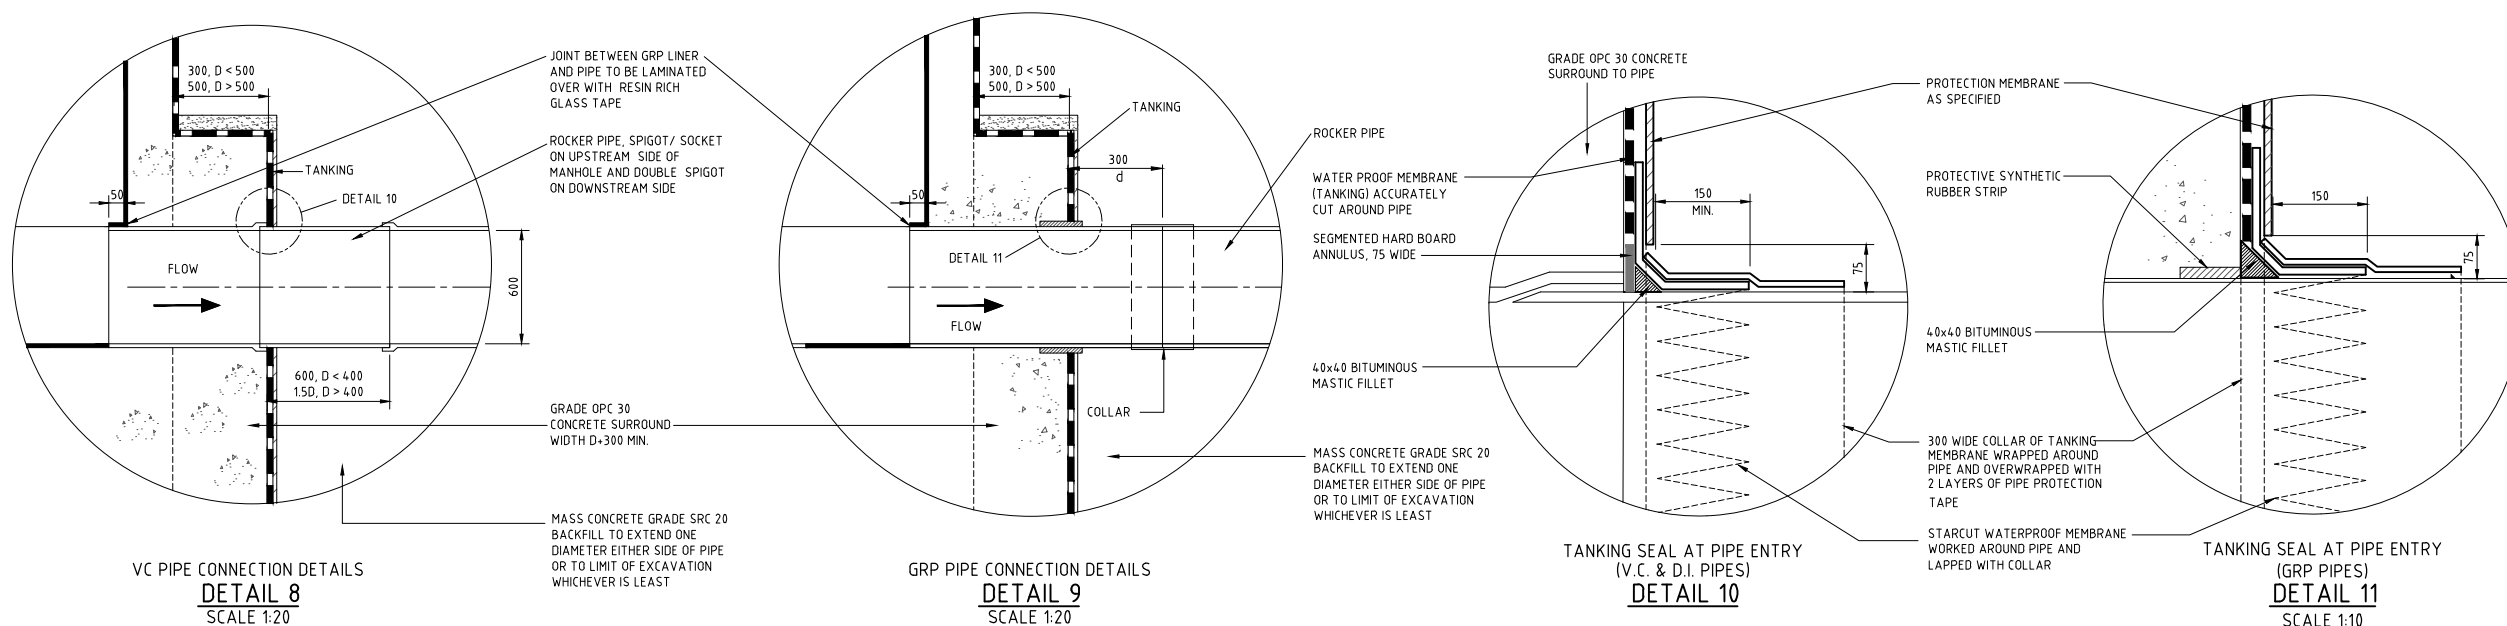
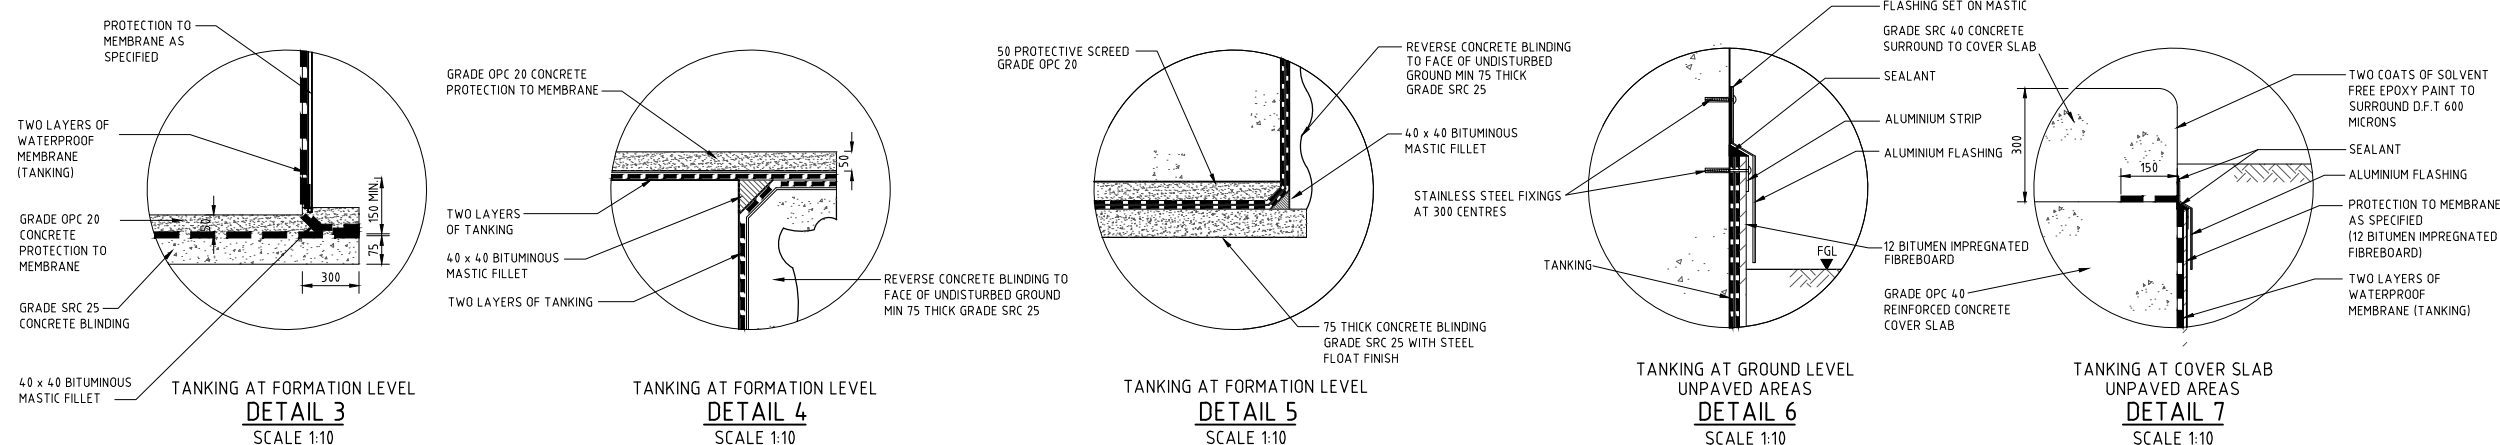
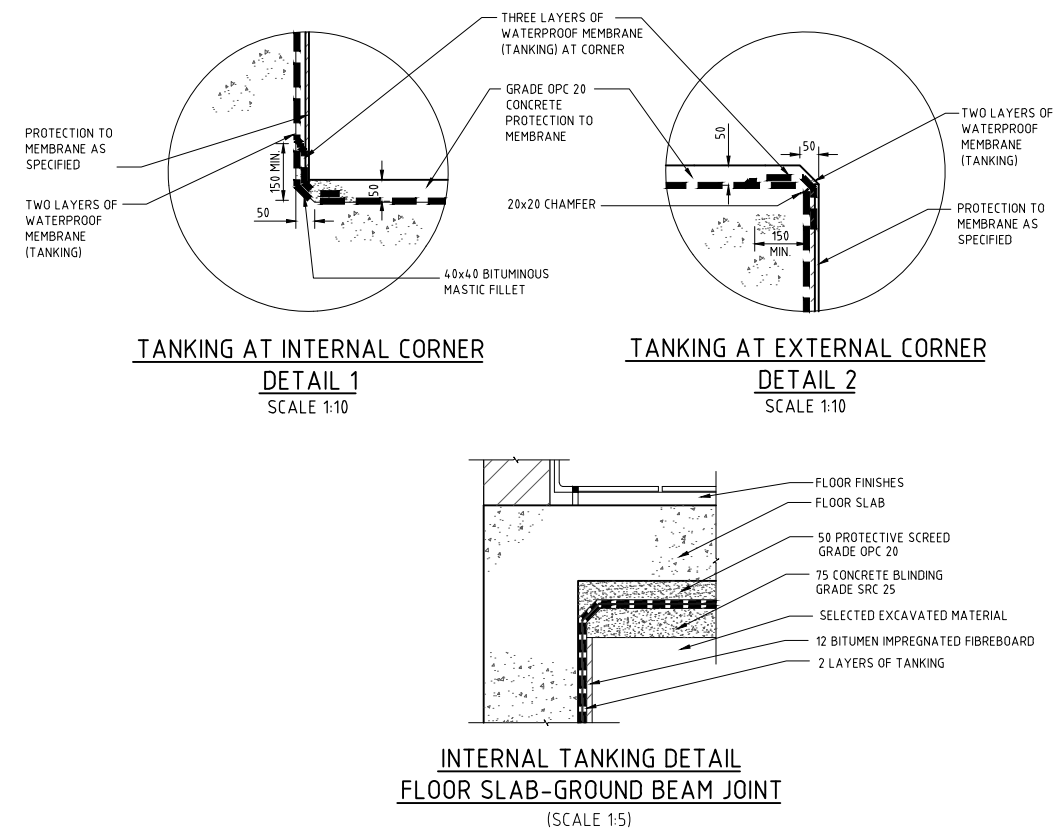


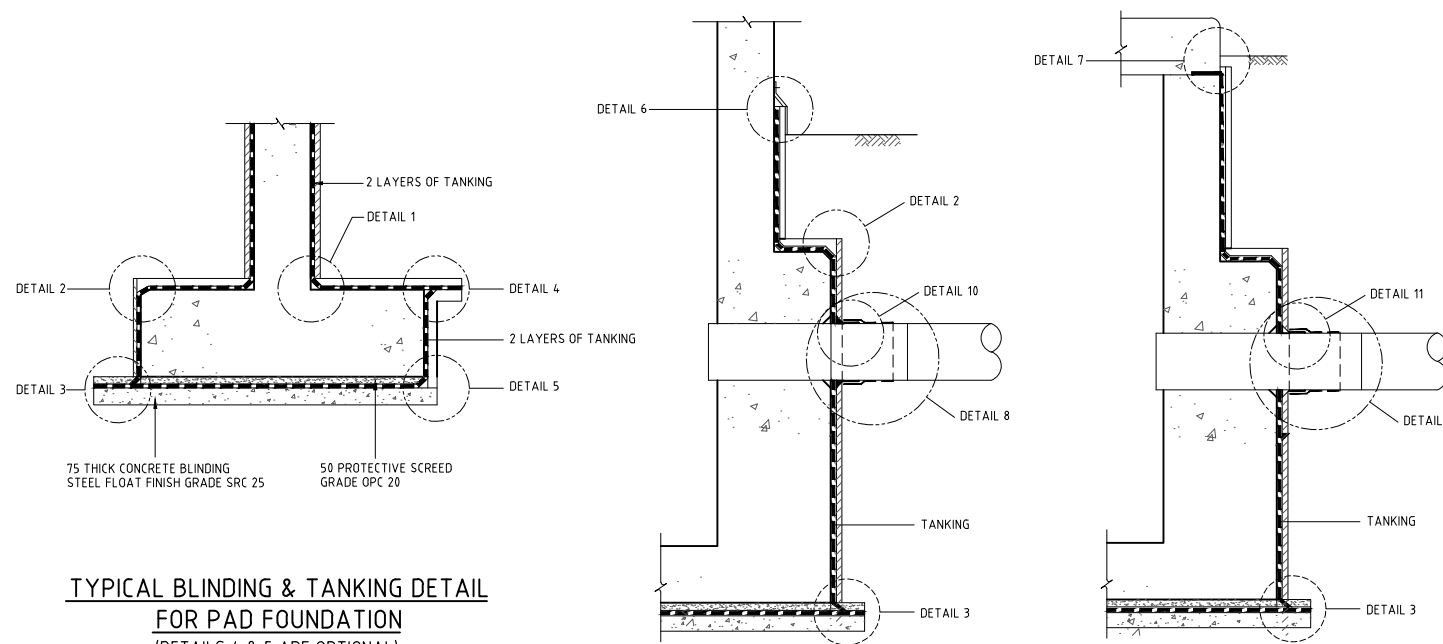

# NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
- ALL MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE CURRENT Q.C.S. UNLESS OTHERWISE AGREED WITH THE ENGINEER.
- THE DRAWING SHOULD BE READ IN CONJUNCTION WITH DETAILS SHOWN ON STANDARD DRAWINGS.
- VARIATION TO STANDARD DETAILS ARE PERMITTED TO MEET SITE SPECIFIC REQUIREMENTS SUBJECT TO ENGINEERS APPROVAL.
- WALL AND BASE SLAB THICKNESS SHALL BE DESIGNED TO RESIST FLOATATION AND SUIT SITE CONDITIONS.
- MINIMUM STRENGTH OF EPOXY MORTAR 30 N/mm<sup>2</sup>.

|   |           |                   |  |
|---|-----------|-------------------|--|
| 3 | APR 19    | ISSUED FOR USE    |  |
| 2 | 01 MAR 19 | REVALIDATED ISSUE |  |
| 1 | 23 NOV 15 | ISSUED FOR USE    |  |
| 0 | 15 SEP 13 | ISSUED FOR USE    |  |

| Rev. | Date | Revision Details | Appd. |
|------|------|------------------|-------|
|------|------|------------------|-------|

هيئة الأشغال العامة  
Public Works Authority

P.O. Box: 22188  
Tel.: 00974 44950000  
Fax: 00974 44950999  
**PA**  
PROJECTS AFFAIRS  
QCS Section:  
Section 8 - Drainage Works  
Part 4 - Pipeline Installation

Drawing Title:

## TANKING DETAILS

|                            |                  |
|----------------------------|------------------|
| Approved:                  | Sheet No: 1 OF 1 |
| Date: APRIL 2019           | Scale: AS SHOWN  |
| Drawing Number: SD 8-4-103 | Revision: 3      |